

Product description

The bks+ ultrasonic web edge sensor is a fork sensor for scanning the edges of sound-impermeable materials such as foil or paper.

The fork's lower leg is equipped with an ultrasonic sensor which cyclically emits short sound impulses, which are detected by the ultrasonic receiver accommodated in the upper fork leg. Material immersing into the fork covers this sound path and thus attenuates the receive signal, which is evaluated by the internal electronics. An analogue signal is output in dependence of the coverage degree.

Using the LinkControl-Adapter LCA-2 and LinkControl software, the switched output can be programmed in window mode around the zero position.

- Via the Teach-in button on the edge sensor's top, the sensor can be adjusted to the material to be controlled.
- Choosing between rising and falling output characteristic is possible.
- Three LEDs indicate the position of the web material inside the fork.

IO-Link

The bks+ sensors are IO-Link-capable in accordance with IO-Link specification V1.1.

Safety Notes

- Read the operating instructions prior to start-up.
- Connection, installation and adjustment works may only be carried out by expert personnel.
- No safety component in accordance with the EU Machine Directive.

Installation

- Mount the sensor at the installation site.
- Connect a connection cable to the M12 device plug.
- For optimum measurement results the sensor should be mounted thermally conductive.

Start-Up

- Connect the power supply.
- Carry out the adjustment in accordance with the diagram.

Synchronisation

If two or more edge sensors are mounted in a distance < 400 mm the internal synchronisation should be used. Connect Sync-channels (Pin 5 at the units receptacle) of all sensors.

Factory setting

- Analogue output on voltage output.
- Rising analogue characteristic (0 V at maximum coverage).
- Switched output on NCC.
- Switched output window is ± 1.5 mm around zero position.

Maintenance

microsonic sensors are maintenance-free. With heavy dirt deposits, we recommend a cleaning of the white sensor surface.

Notes

- For optimum measurement results the material to be detected should be kept in a range of ± 5 mm around the centre between the upper and lower fork leg.
- The sensor can be reset to its

factory settings (see »Further settings«).

- Carry out the adjustment only after reaching the operating temperature (approx. 20 min).
- Using the LinkControl-Adapter LCA-2 (optional accessory) and the LinkControl-Software V7.6 all Teach-in- and additional sensor parameter settings may be made.
- Depending on the function the ultrasonic transducers in the upper and lower fork leg are mounted with a slope of 2°.




2014/30/EU

Operating Manual

bks+3/FIU Ultrasonic web edge sensor with analogue output and IO-Link interface




Sensor adjustment with Teach-in procedure

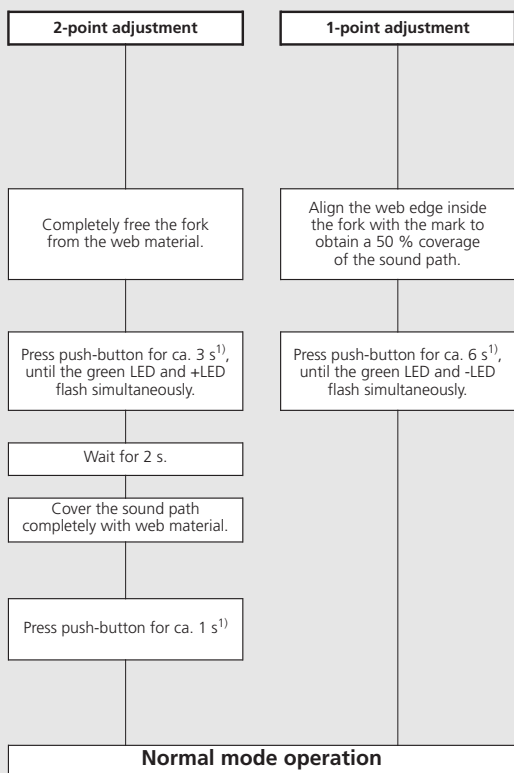

Adjust sensor to web edge

¹⁾ or connect Pin5 (Sync/Com) to +U_B


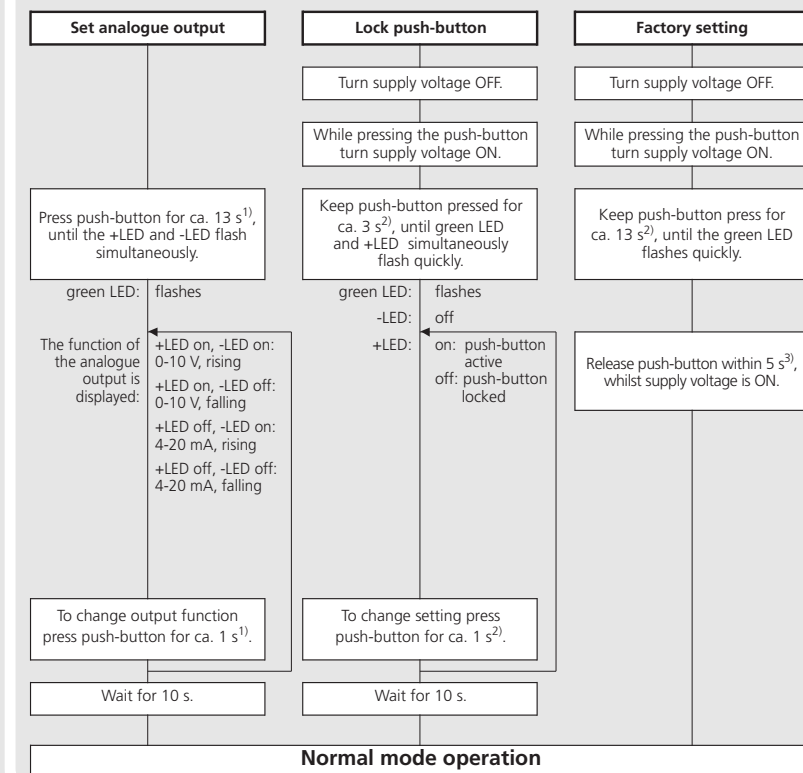


Further settings

²⁾ or connect Pin5 (Sync/Com) to -U_B ³⁾ or disconnect Pin5 (Sync/Com) from -U_B

Technical data

fork width	30 mm
fork depth	43 mm
operating range	min. 12 mm (± 6 mm)
transducer frequency	170 kHz
resolution	< 0.005 mm
operating voltage U_B	20 to 30 V DC, reverse polarity protection
voltage ripple	± 10 %
no-load current consumption	≤ 60 mA
housing	zinc die cast lacquered, plastic parts: PBT ultrasonic transducer: polyurethane foam, epoxy resin with glass contents
class of protection to EN 60 529	IP 65
type of connection	5-pin M12 initiator plug, brass, nickel-plated
controls	Teach-in-button
indicators	LED green: centre or within switching window LEDs yellow: deviation from centre/switching window
programmable	LCA-2 with LinkControl
synchronisation	internal synchronisation up to 10 sensors
operating temperature	+5°C to +60°C
storage temperature	-40°C to +85°C
weight	190 g
response time	5.1 ms
repetition rate	4 ms
time delay before availability	< 300 ms
order no.	bks+3/FIU
analogue output	current output 4-20 mA voltage output 0-10 V
switched output	short-circuit-proof, switchable rising/falling Push-Pull, U _B -4V, -U _B +2 V, I _{max} = 100 mA switchable NOC/NCC; short-circuit-proof

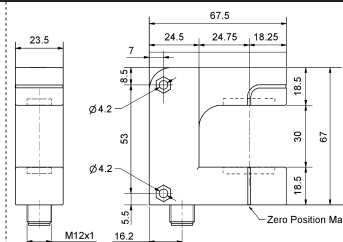

1 Push-Pull switched output and analogue output

IO-Link Mode

The bks+ sensors are IO-Link-capable in accordance with IO-Link specification V1.1 and compatible to V1.0.

Note

- In IO-Link mode Teach-in and Link-Control are not available.

Process data

The bks+ cyclically transmits the value corresponding to the measured coverage degree with a resolution of 0.003 mm.

Service data

The following sensor parameters may be set via IO-Link.

Teach-in via push-button

The push-button can be activated/deactivated for sensor settings with Teach-in.

Linearisation of the output characteristic

To increase the absolute accuracy in the edge areas, the linearisation of the output characteristic can be disabled.

Temperature compensation

The temperature compensation is used for measurement value correction for varying ambient temperatures and can be disabled.

Analogue output mode

For the analogue output either the function output voltage or current output can be selected.

Rising / falling analogue characteristic

The analogue characteristic can be set on rising (0 V / 4 mA at full coverage) or falling characteristic.

Set NOC/NCC

The NCC or NOC output function can be preset for the switched output.

Switching off the LEDs

When activated, the LEDs are switched

off 30 seconds after a key press. After a new key press they will run for 30 seconds. This automatic shutdown can be deactivated.

Measurement filter

bks+ ultrasonic sensors provide a choice of 3 filter settings:

- F00 (no filter)
Each ultrasonic measurement acts on the output in an unfiltered manner.
- F01 (average value filter)
Forms approximately the arithmetic mean of several measurements. According to the mean value the output is set. The number of measurements, from which the mean is formed is dependent on the chosen filter strength.
- F02 (median filter)
Finds the median of several measurements. According to the median the output is set. The number of measurements, for which the median is determined is dependent on the selected filter strength.

System commands

- With 5 system commands the following settings may be carried out:
- restore IO-Link parameter (default)
 - sensor adjustment: fork cleared.
 - sensor adjustment: fork 50 % covered
 - sensor adjustment: fork 100 % covered
 - Reset to factory settings.

Events

The bks+ sensor sends the following events:

- parameter was changed
- sensor adjustment successful
- sensor adjustment failed

IODD file

The latest IODD file you will find on the internet under www.microsonic.de/en/IODD.

For further informations on IO-Link see www.io-link.com.

IO-Link Data

physical layer		bks+3/FIU	
IO-Link revision	V1.1		
compatibility	V1.0		
block parameter	yes		
data storage	yes		
SIO mode support	yes		
min. cycle time	4 ms		
baud rate	COM 2		
format of process data	16 Bit, R, UNI16		
content of process data	Bit 0-15: degree of coverage with 0.003 mm resolution		
service data IO-Link specific			
index		access	value
vendor name	0x10	R	microsonic GmbH
vendor text	0x11	R	www.microsonic.de
product name	0x12	R	bks+
product ID	0x13	R	bks+3/FIU
product text	0x14	R	Ultraschall-Sensor
service data sensor specific			
index	format	access	range
Teach-in via push-button	0x40	UINTE8 R/W	0: activated; 1: deactivated
linearisation of the output characteristic	0x41	UINTE8 R/W	0: deactivated; 1: activated
temperature compensation	0x42	UINTE8 R/W	0: deactivated; 1: activated
analogue output mode	0x44	UINTE8 R/W	2: current output, 3: voltage output
rising/falling output characteristic curve	0x45	UINTE8 R/W	0: rising characteristic curve; 1: falling characteristic curve
NCC/NOC	0x46	UINTE8 R/W	0: NOC; 1: NCC
automatic turning-off LEDs	0x48	UINTE8 R/W	0: deactivated; 1: activated
measurement filter	0x4D	UINTE8 R/W	0-2: F00-F02
filter strength	0x4E	UINTE8 R/W	0-9: P00-P09
centre of switching window	0x4F	UINTE16 R/W	0-4095 ¹⁾
width of switching window	0x50	UINTE16 R/W	0-4095 ¹⁾
default			
			0
			1
			1
			3
			1
			1
			1
			0
			0
			2047
			1023
system commands			
index		access	value
restore IO-Link parameter	0x02	W	130
sensor adjustment: fork cleared	0x02	W	161
sensor adjustment: fork 50 % covered	0x02	W	162
sensor adjustment: fork 100 % covered	0x02	W	163
reset to factory setting	0x02	W	164
events			
code	type	name	
0x8ca0	Notification	parameter was changed	
0x8ca1	Notification	sensor adjustment successful	
0x8ca2	Notification	sensor adjustment failed	
observe			
index	format	access	range
measurement value	0x54	UINTE16 R	0-4095

¹⁾ Measurement values are expressed as multiples of the internal resolution of about 0.003 mm.

Filter strength

For each measurement value filter, a filter strength between P00 (weak filter effect) and P09 (strong filter effect) can be selected.

Switching window

If the web edge is within the switching window the switching output is set. The switching window is defined by the adjusted center and the width.

Note

The switching window has to be completely within the operating range.

